



戶外型LCD溫濕度(RS485)通訊協定


TCS-T3000-1CDB

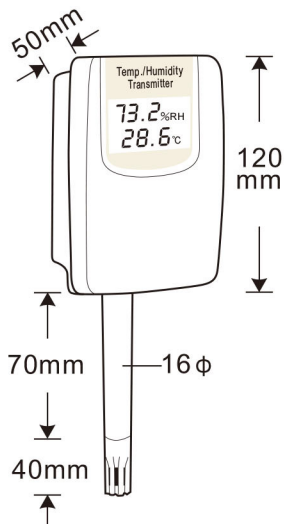

TCS-T3000-2CDB

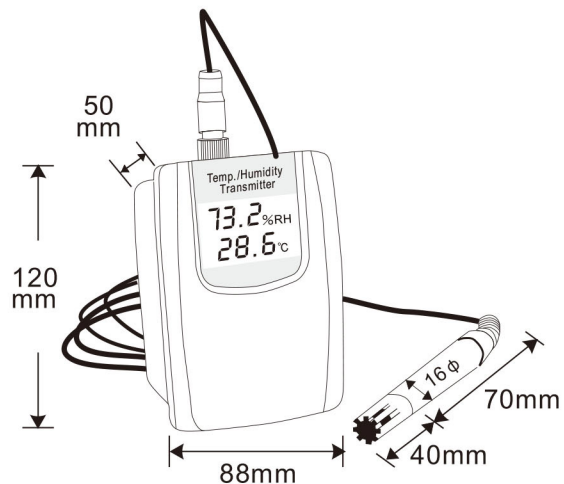

① 選擇溫度對應範圍

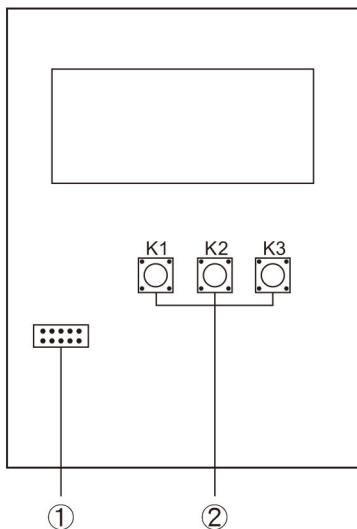

2	1	
●	●	0~100
●	●	0~50
●	●	+ -50
●	●	Free range
●	●	C/F
10	9	

1 和 2 :

3 和 4 :

5 和 6 :

7 和 8 :

9 和 10 : 短路時顯示單位為°F，開路時為°C

② 按鍵說明

K1 : Mode 鍵

K2 : 上加鍵

K3 : 下減鍵

Mosbus RTU Address

Address	Code	Word	Function	Range
0000H	03H	1	Temperature	-400~1328 (-40.0~132.8°C)=FE70H~0530H
0001H	03H	1	Humidity	0~1000 (0~100.0%)=0000H~03E8H
0002H	03/06H	1	Temperature adjustment	-100~100 (-10.0~10.0°C/±10°C)=009CH~0064H
0003H	03/06H	1	Humidity adjustment	-100~100 (-10.0~10.0%/±10%)=009CH~0064H
0004H	03/06H	1	Sampling time	10~100 (1.0~10.0秒)=000AH~0064H